TI-P078-02 CHe CH Issue 9 07.09

Spirax Sarco KA31, KA33, KB31, KB33 and KC31 Cast Iron Self-acting Control Valves

Description

The KA, KB and KC range of two-port valves are used in conjunction with Spirax Sarco SA control systems to provide a self-acting temperature control unit.

Alternatively, they can be used as electrically actuated temperature control valves by fitting an EL3500 Series electric actuator with a suitable temperature transmitter and controller.

Available types

KA31 Normally open with screwed connections.	
KA33 Normally open with flanged connections.	

- **KB31** Normally open with phosphor bronze balancing bellows and screwed connections.
- **KB33** Normally open with phosphor bronze balancing bellows and flanged connections.

KC31 Normally open with stainless steel balancing bellows and screwed connections.

Note: Pressure balancing bellows enables the valve to operate against higher differential pressures.


Standards

These products fully comply with the requirements of the European Pressure Equipment Directive 97/23/EC and carry the **(** ϵ mark when so required.

Certification

As standard these products are available with a manufacturers' Typical Test Report. **Note:** All certification/inspection requirements must be stated at the time of order placement.


Pressure / temperature limits

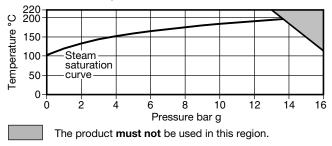



PN16
16 bar g @ 120°C
220°C @ 13.8 bar g
-10°C
220°C
0°C
onsult Spirax Sarco
N32 DN40 DN50
3.0 2.0 1.5
3.0 2.0 1.5
9.0 8.2 6.9
9.0 8.2 6.9
- 13.0 13.0

Sizes and pipe connections

Screwed BSP (BS 21 parallel) or NPT: KA31 ½", ¾", 1", 1¼", 1½" and 2" KB31 1", 1¼", 1½" and 2" KC31 1½" and 2" Flanged EN 1092 PN16 and BS 10 Table F: KA33 DN15, DN20, DN25, DN32, DN40 and DN50 KB33 DN25, DN32, DN40 and DN50

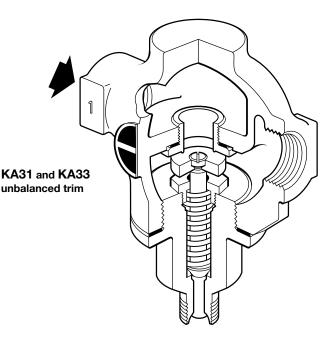

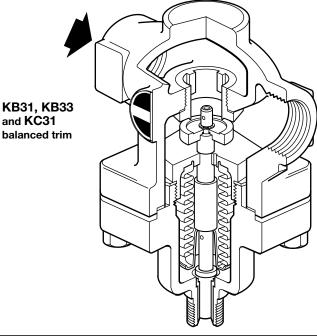

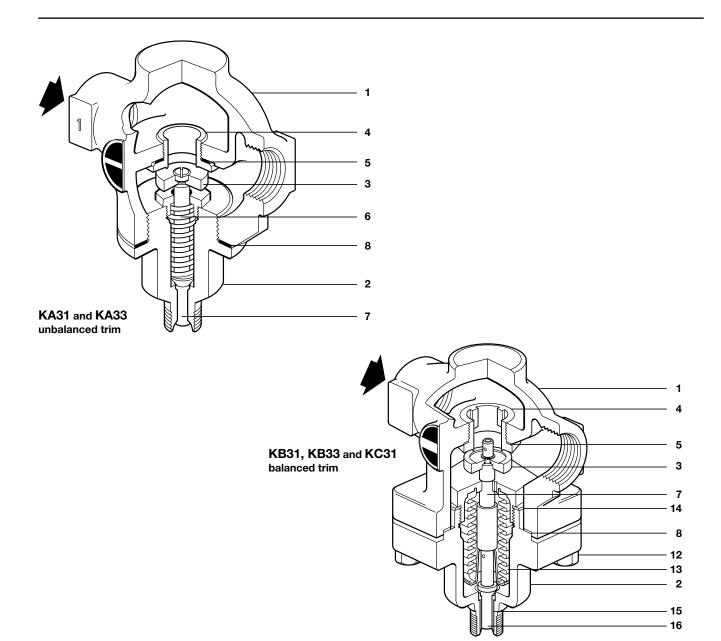

Materials

No	. Part		Material	
1	Body		Cast iron	DIN 1561 EN-JL1040
		KA and KB	Cast iron	DIN 1561 EN-JL1040
2	Bonnet	KC - 1½"	Cast iron	DIN 1561 EN-JL1040
		KC - 2"	Steel	EN 10213 GP240 GH+N
3	Valve head		Stainless steel	BS 970 431 S 29
4	Valve seat ring		Stainless steel	BS 970 431 S 29
5	Value east geaket	DN15-DN25	Mild steel	BS 1449 CS 4
5	Valve seat gasket DN32 - DN50		Reinforced exfoliated graphite	
6	Return spring		Stainless steel	BS 2056 302 S 26
-	Stem	KA and KB	Brass	BS 2874 CZ 121
'	Stem	KC	Stainless steel	BS 970 321S20
8	Bonnet gasket		Reinforced exfoliated graphite	
12	Bonnet studs		Steel	BS 4439 Gr. 8.8
12	Bonnet nuts		Steel	BS 3692 Gr. 8
13	Bellows	KB	Phosphor bronze	EN 12449 Cu Sn 6
13	Dellows	KC	Stainless steel	AISI 316 L
14	Bellows gasket		Reinforced exfoliated graphite	
15	Bonnet bush		Brass	BS 2874 CZ 121
16	Plunger		Brass	BS 2874 CZ 121

Ky values

Size	DN15	DN20	DN25	DN32	DN40	DN50
KA31, KA33	2.90	4.64	9.80	16.48	23.70	34.00
KB31, KB33	-	-	9.80	16.48	23.70	34.00
KC31	-	-	-	-	16.48	34.00
For conversati	ion: C	_v (UK) = I	< _ν x 0.96	3 C _v	$(US) = K_v$	x 1.156


Capacities

For saturated steam sizing capacities see TI-GCM-08. For water valve sizing capacities see TI-GCM-09.

Dimensions/weights (approximate) in mm and kg KA31 and KA33

		PN16	BS 10'I	-		We	ight
Size	Α	A1	A1	В	С	Scr.	Flg.
DN15-1/2"	90	130	130	105	37	1.3	3.3
DN20-3/4"	104	150	147	105	37	1.6	4.3
DN25-1"	136	160	157	107	51	3.2	5.7
DN32-1¼"	144	180	180	110	-	5.1	8.8
DN40-1½"	150	200	200	110	-	6.3	11.0
DN50-2"	180	230	230	110	-	7.8	13.0
KB31, KB33	KB31, KB33 and KC31						

DN25-1"	136	160	157	138	51	3.4	5.9
DN32-1¼"	144	180	180	152	51	5.7	9.1
DN40-1½"	150	200	200	152	62	6.9	11.2
DN50-2"	180	230	230	152	71	8.8	13.4

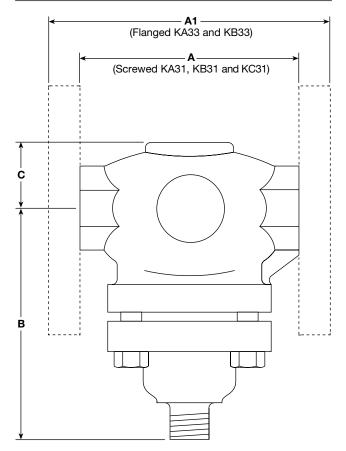

Safety information, installation and maintenance

For full details see the Installation and Maintenance Instructions (IM-S21-01) supplied with the product.

Installation note: The valve should be fitted in a horizontal line with the actuator vertically below the pipeline.

How to order

Example: 1 off Spirax Sarco 11/4" screwed BSP KA31 self-acting control valve with cast iron body.

Spare parts

The spare parts available are shown in solid outline. Parts drawn in broken line are not supplied as spares.

Available spares

KAST and KASS	
Valve seat assembly	A, D, E, L
Set of all gaskets	E, L
Set of bonnet studs and nuts (set of 4)	S
KB31, KB33 and KC31	
Valve seat assembly	A, B, C, D, E

(excluding bellows and stem assembly)	L, U, G
Bellows and stem assembly	G, L, N, H
Set of all gaskets	B, C, E, L, U, G
Set of bonnet studs and nuts (set of 4)	S

How to order spares

Always order spares by using the description given in the column headed 'Available spares' and state the size and type of valve. **Example:** 1 - Valve seat assembly for a Spirax Sarco DN32 KB31 self-acting control valve.

